
Nitrogen Fee vs Effluent & Years of Mitigation

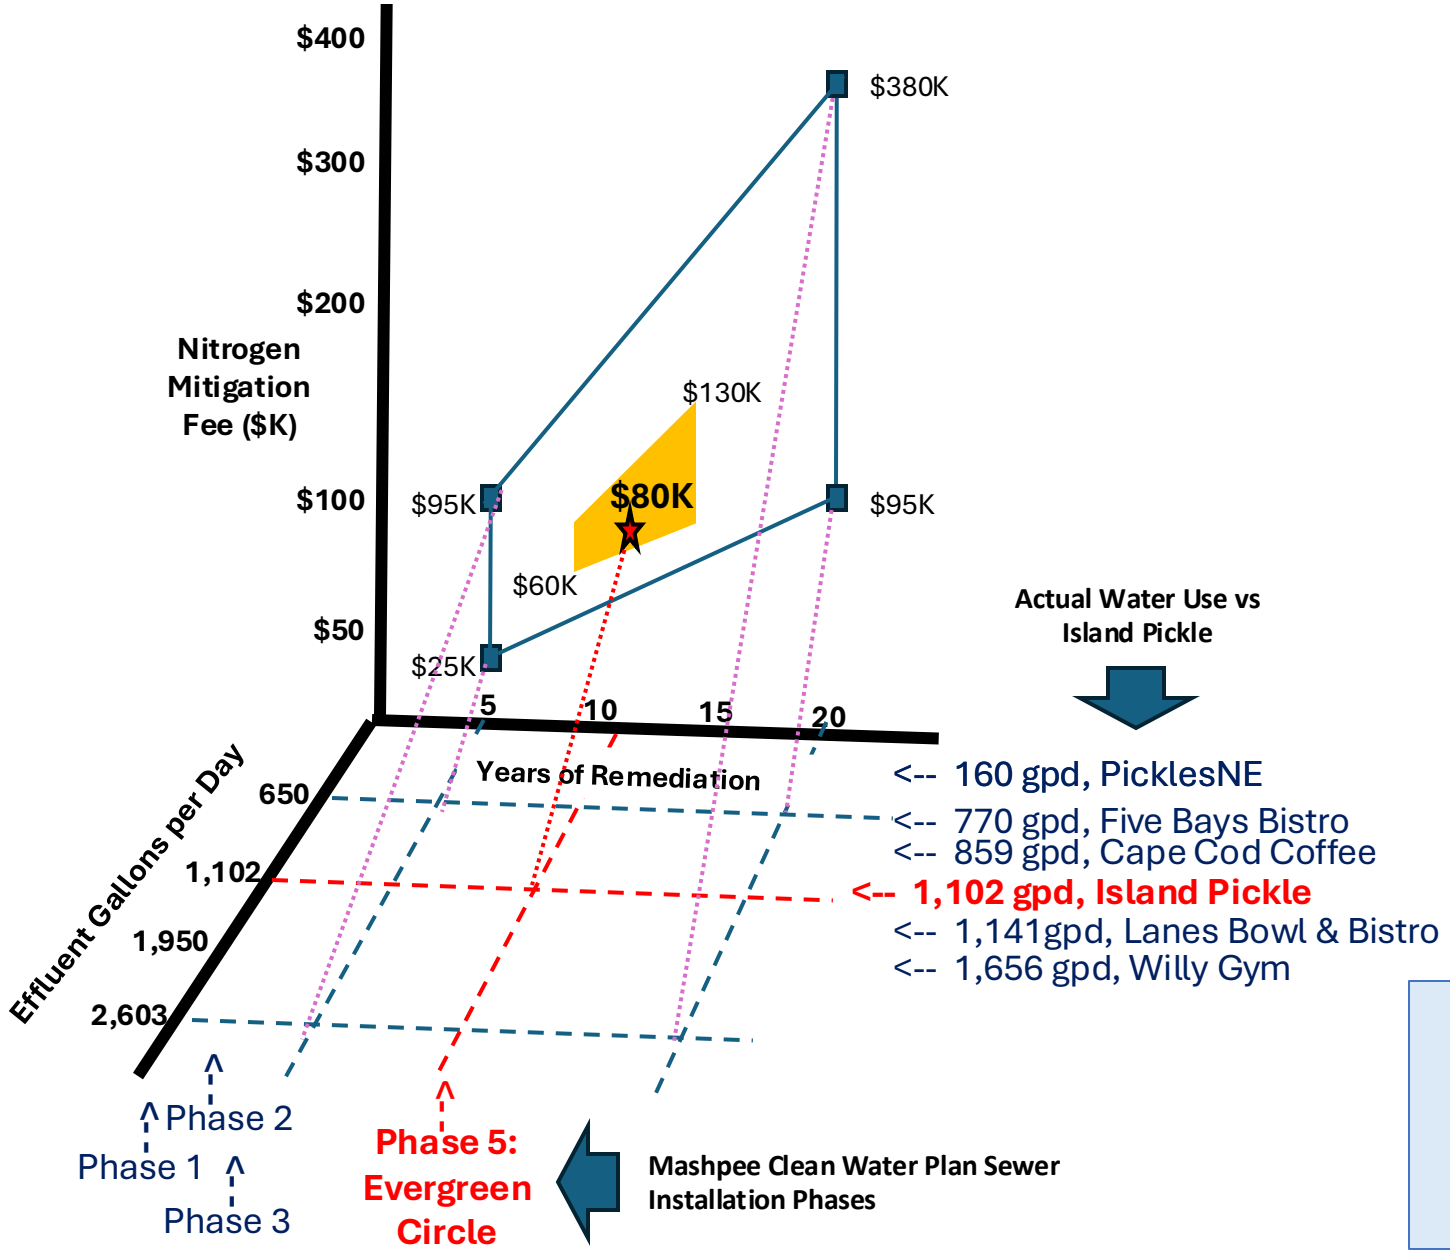

- As stated by CCC staff at 2Dec hearing:
  - Fee should be proportional to the project output
  - Phase 5 of the Mashpee Clean Water Plan will reach Evergreen Circle in 2035-2040
  - Fee should not be punitive
- Mandated reform required by 2023 MA Clean Water Act is not accounted for in 2018 RPP language
- An argument for or against a fee increase or reduction should not be based upon inflation nor upon technological advances
- Low flow toilets and urinals matter. Less water, less effluent, less nitrogen to mitigate

A fee of $80K is the applicant's proposal.

$60K to $130K would be proportional to the project's range of effluent output and remediation timeframe.

A fee in this range is appropriate and non-punitive.